

**MARYLAND HISTORICAL TRUST  
NR-ELIGIBILITY REVIEW FORM**

NR Eligible: yes   
no

Property Name: Small Structure No. 14007XO K-552

Address: MD 313 over Trib. Of Cypress Branch City: Laurel, MD Zip Code: N/A

County: Kent USGS Topographic Map: Millington

Owner: MD SHA

Tax Parcel Number: N/A Tax Map Number: N/A Tax Account ID Number: N/A

Project: MD 313 over Trib. Of Cypress Branch Agency: SHA

Site visit by MHT Staff:  no  yes Name: \_\_\_\_\_ Date: \_\_\_\_\_

Eligibility recommended  Eligibility **not** recommended

Criteria:  A  B  C  D Considerations:  A  B  C  D  E  F  G  None

Is the property located within a historic district?  no  yes Name of district: \_\_\_\_\_

Is district listed?  no  yes Determined eligible?  no  yes District Inventory Number: \_\_\_\_\_

Documentation on the property/district is presented in: Compliance Files


Description of Property and Eligibility Determination: *(Use continuation sheet if necessary and attach map and photo)*

Structure No. 14007XO is not eligible for listing in the National Register due to lack of integrity. This structure is a standard concrete slab, with eleven-foot span, built at an unknown date, which has been repaired repeatedly to address scour problems. We have determined that this structure lacks the requisite integrity to be considered eligible for inclusion in the National Register as a type of concrete slab small structure. To be considered for listing, according to the Small Structures on Maryland's Roads, Historic Context Report (p. 4-10) concrete slab small structures should retain parapets, abutments and wingwalls as primary character defining elements of the substructure. Structural damage requiring past repair has compromised the integrity of these elements. Recent inspection reports have documented scour, and undermining of the abutments. These defects have undermined the integrity of this structure.

Prepared by: Rita M. Suffness

Date Prepared: April 16, 2001

<b>MARYLAND HISTORICAL TRUST REVIEW</b>	
Eligibility recommended <input type="checkbox"/>	Eligibility not recommended <input checked="" type="checkbox"/>
Criteria: <input type="checkbox"/> A <input type="checkbox"/> B <input type="checkbox"/> C <input type="checkbox"/> D	Considerations: <input type="checkbox"/> A <input type="checkbox"/> B <input type="checkbox"/> C <input type="checkbox"/> D <input type="checkbox"/> E <input type="checkbox"/> F <input type="checkbox"/> G <input type="checkbox"/> None
Comments: _____	
<u>Andrew Lewis</u>	<u>05/29/01</u>
Reviewer, Office of Preservation Services	Date
<u>B. Kuntz</u>	<u>5/30/01</u>
Reviewer, NR program	Date

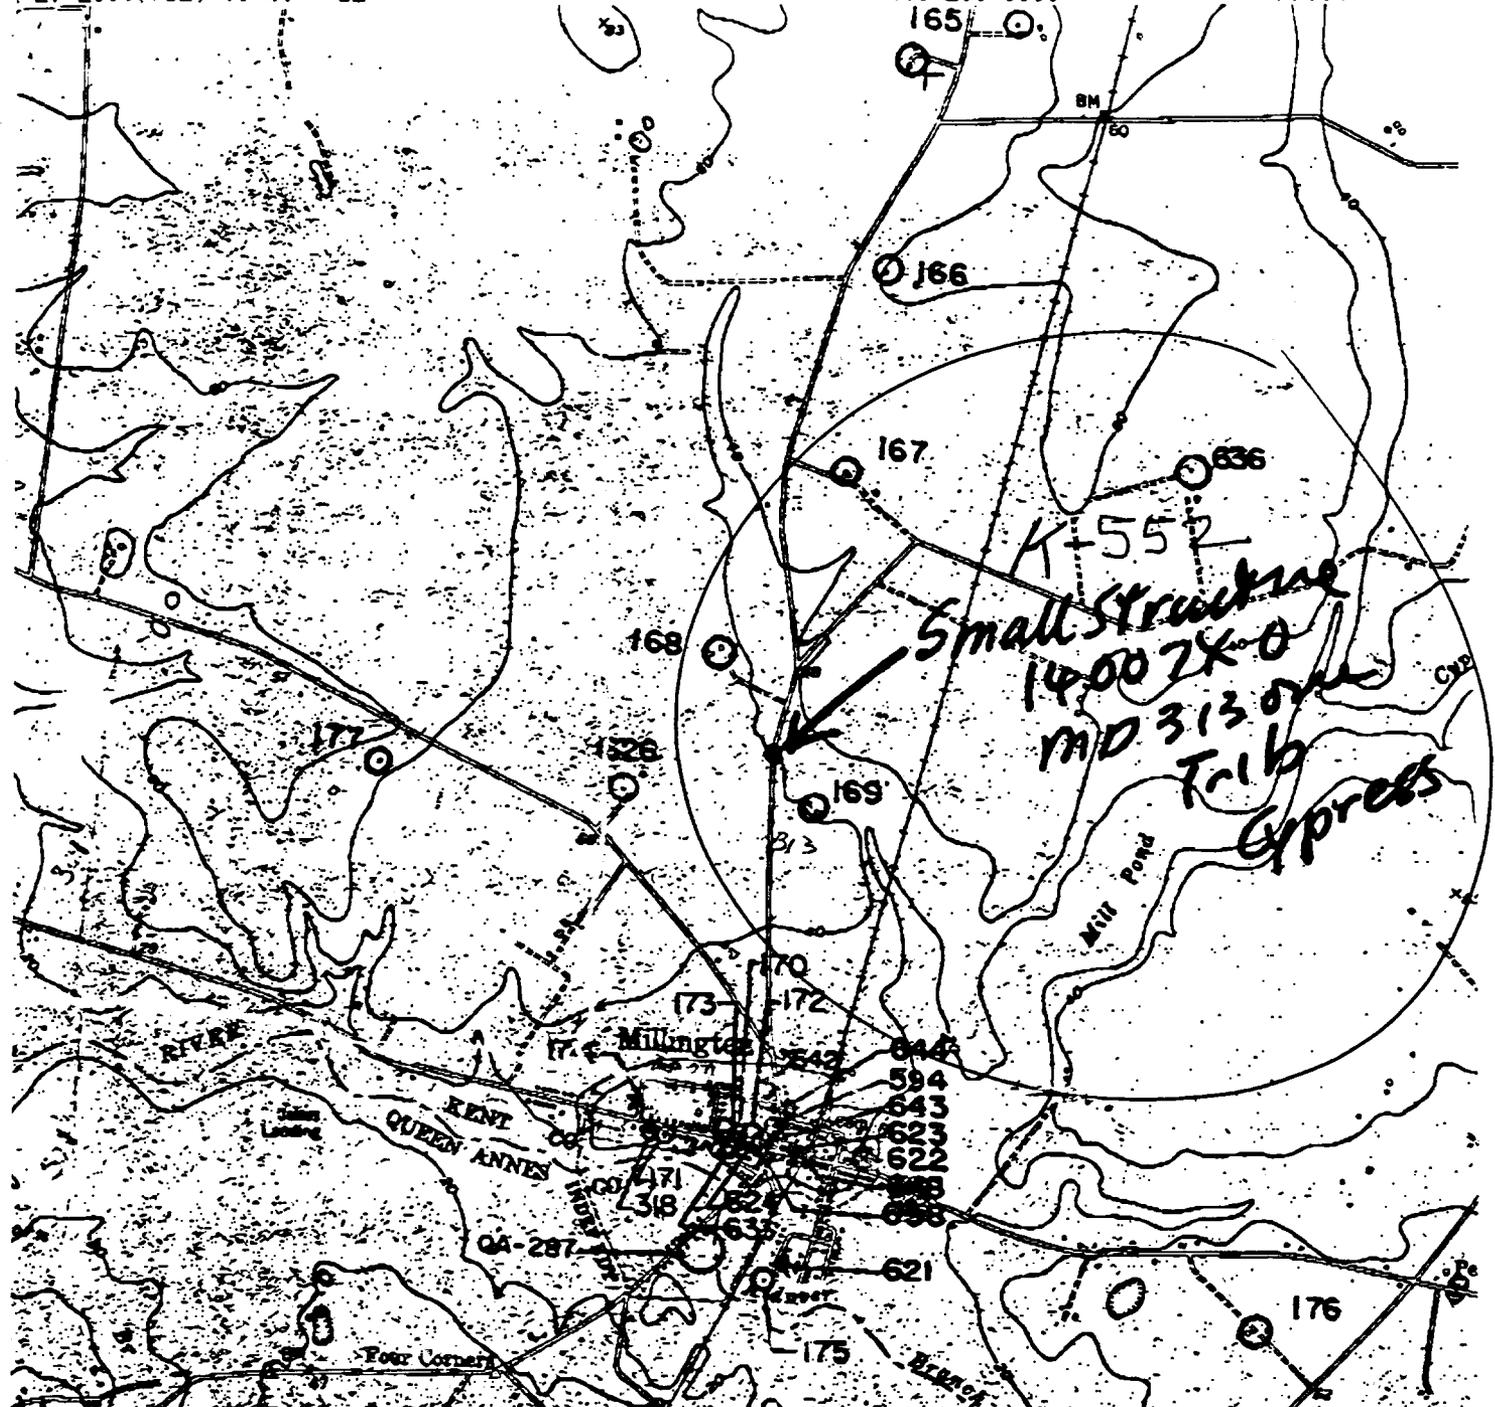

300 000 FEET (DELT)

**MILLINGTON** (INDIVIDUAL LOCATION)

QUEEN ANNES CO. VA. 287

Scale: 1:24,000

FOR LOCALLY ZONED

FOR

INTENSIVE LEVEL SURVEY COURSE INTERVAL 2 NATIONAL GEODETIC VERTICAL

1927 North American

FOR SALE BY U. S. GEOLOGICAL SURVEY, A FOLDER DESCRIBING TOPOGRAPHIC MAPS AND SY



10552

14007X0

1117 313 Ceyraan Branch

14007X0

Looking North

Proj. Engr. 2/93

1/4



K-552

1111 313 (yr. on) Branch

14007X0

Prof. U. S. S. S. R.

Page 11-2-2 2/93

24



K-552

14007XC

MD 313 Cypress Branch

Proj Engineer SH A 7/93

Looking South

3/4



K552

X014007

MD 313 Cypress Creek

Proj Log, 2/93

Profile Inlet ~~1~~

4/4